

SPECIAL NOTES:

ALL DRAWINGS AND DIMENSIONS MUST BE CORRELATED BEFORE PROCEEDING WITH THE PROJECT. ANY DISCREPANCIES MUST BE BROUGHT TO THE ATTENTION OF THE ENGINEER IMMEDIATELY. NO REPRODUCTION OF ANY DRAWING MAY BE USED OTHER THAN THE SITE REFERRED TO.

LEGAL ACTION WILL BE TAKEN IF ANY OF THE INFORMATION IS USED FOR ANY OTHER PROJECT WITHOUT CONSENT OF THE COPYRIGHT OWNERS.

J.M. JANSSEN VAN VUUREN PR TECH/ENG (947079) - ENGINEER

| REVISIONS |        |       |
|-----------|--------|-------|
| No        | Dtg No | Title |
| Date      |        |       |
|           |        |       |
|           |        |       |
|           |        |       |
|           |        |       |
|           |        |       |
|           |        |       |
|           |        |       |
|           |        |       |

DRAWINGS NOTES

Recommended by: \_\_\_\_\_ Date: \_\_\_\_\_

Approved by: \_\_\_\_\_ Date: \_\_\_\_\_

Designed By: J.M.V. \_\_\_\_\_

Design Approval App: J.M.V. \_\_\_\_\_

Client App: \_\_\_\_\_ Date: \_\_\_\_\_

Client: \_\_\_\_\_

RUSTENBURG LOCAL MUNICIPALITY

Engineer:

MR CONSULTING  
21 BOETLOMBARD STREET  
AQUARIPARK  
TZAENEEN

CELL: 074 102 8678

EMAIL: JOHAN@MRCONSULTING.CO.ZA

Project Title:

SPORTS FACILITIES IN WARD 43,  
ERE NO 272 (SERALENG &  
KARLIEN PARK) IN RUSTENBURG  
LOCAL MUNICIPALITY

Drawing Title:

GUARD HOUSE - LIGHTING

Issued For:  
COORDINATION


Drawing No: SER - MRG - 23 - 220 - 505

Rev No: [RE7004]

Date Issued: AUG 2024

LEGEND

|  |  |
|--|--|
|  | Distribution Board                             |
|  | 46W LED Tube Type Vapor Proof<br>≥ 7760 lm     |
|  | 19W LED down Lighter<br>Ceiling Recess Mounted |
|  | Photocell                                      |
|  | 21W Round Bulk 300 ≥ 2100 lm                   |
|  | One Way Light Switch                           |
|  | Two Way Light Switch                           |
|  | One lever 2 Way Light Switch                   |
|  | 600mmx 600mm 30W<br>LED Panel or Equivalent    |

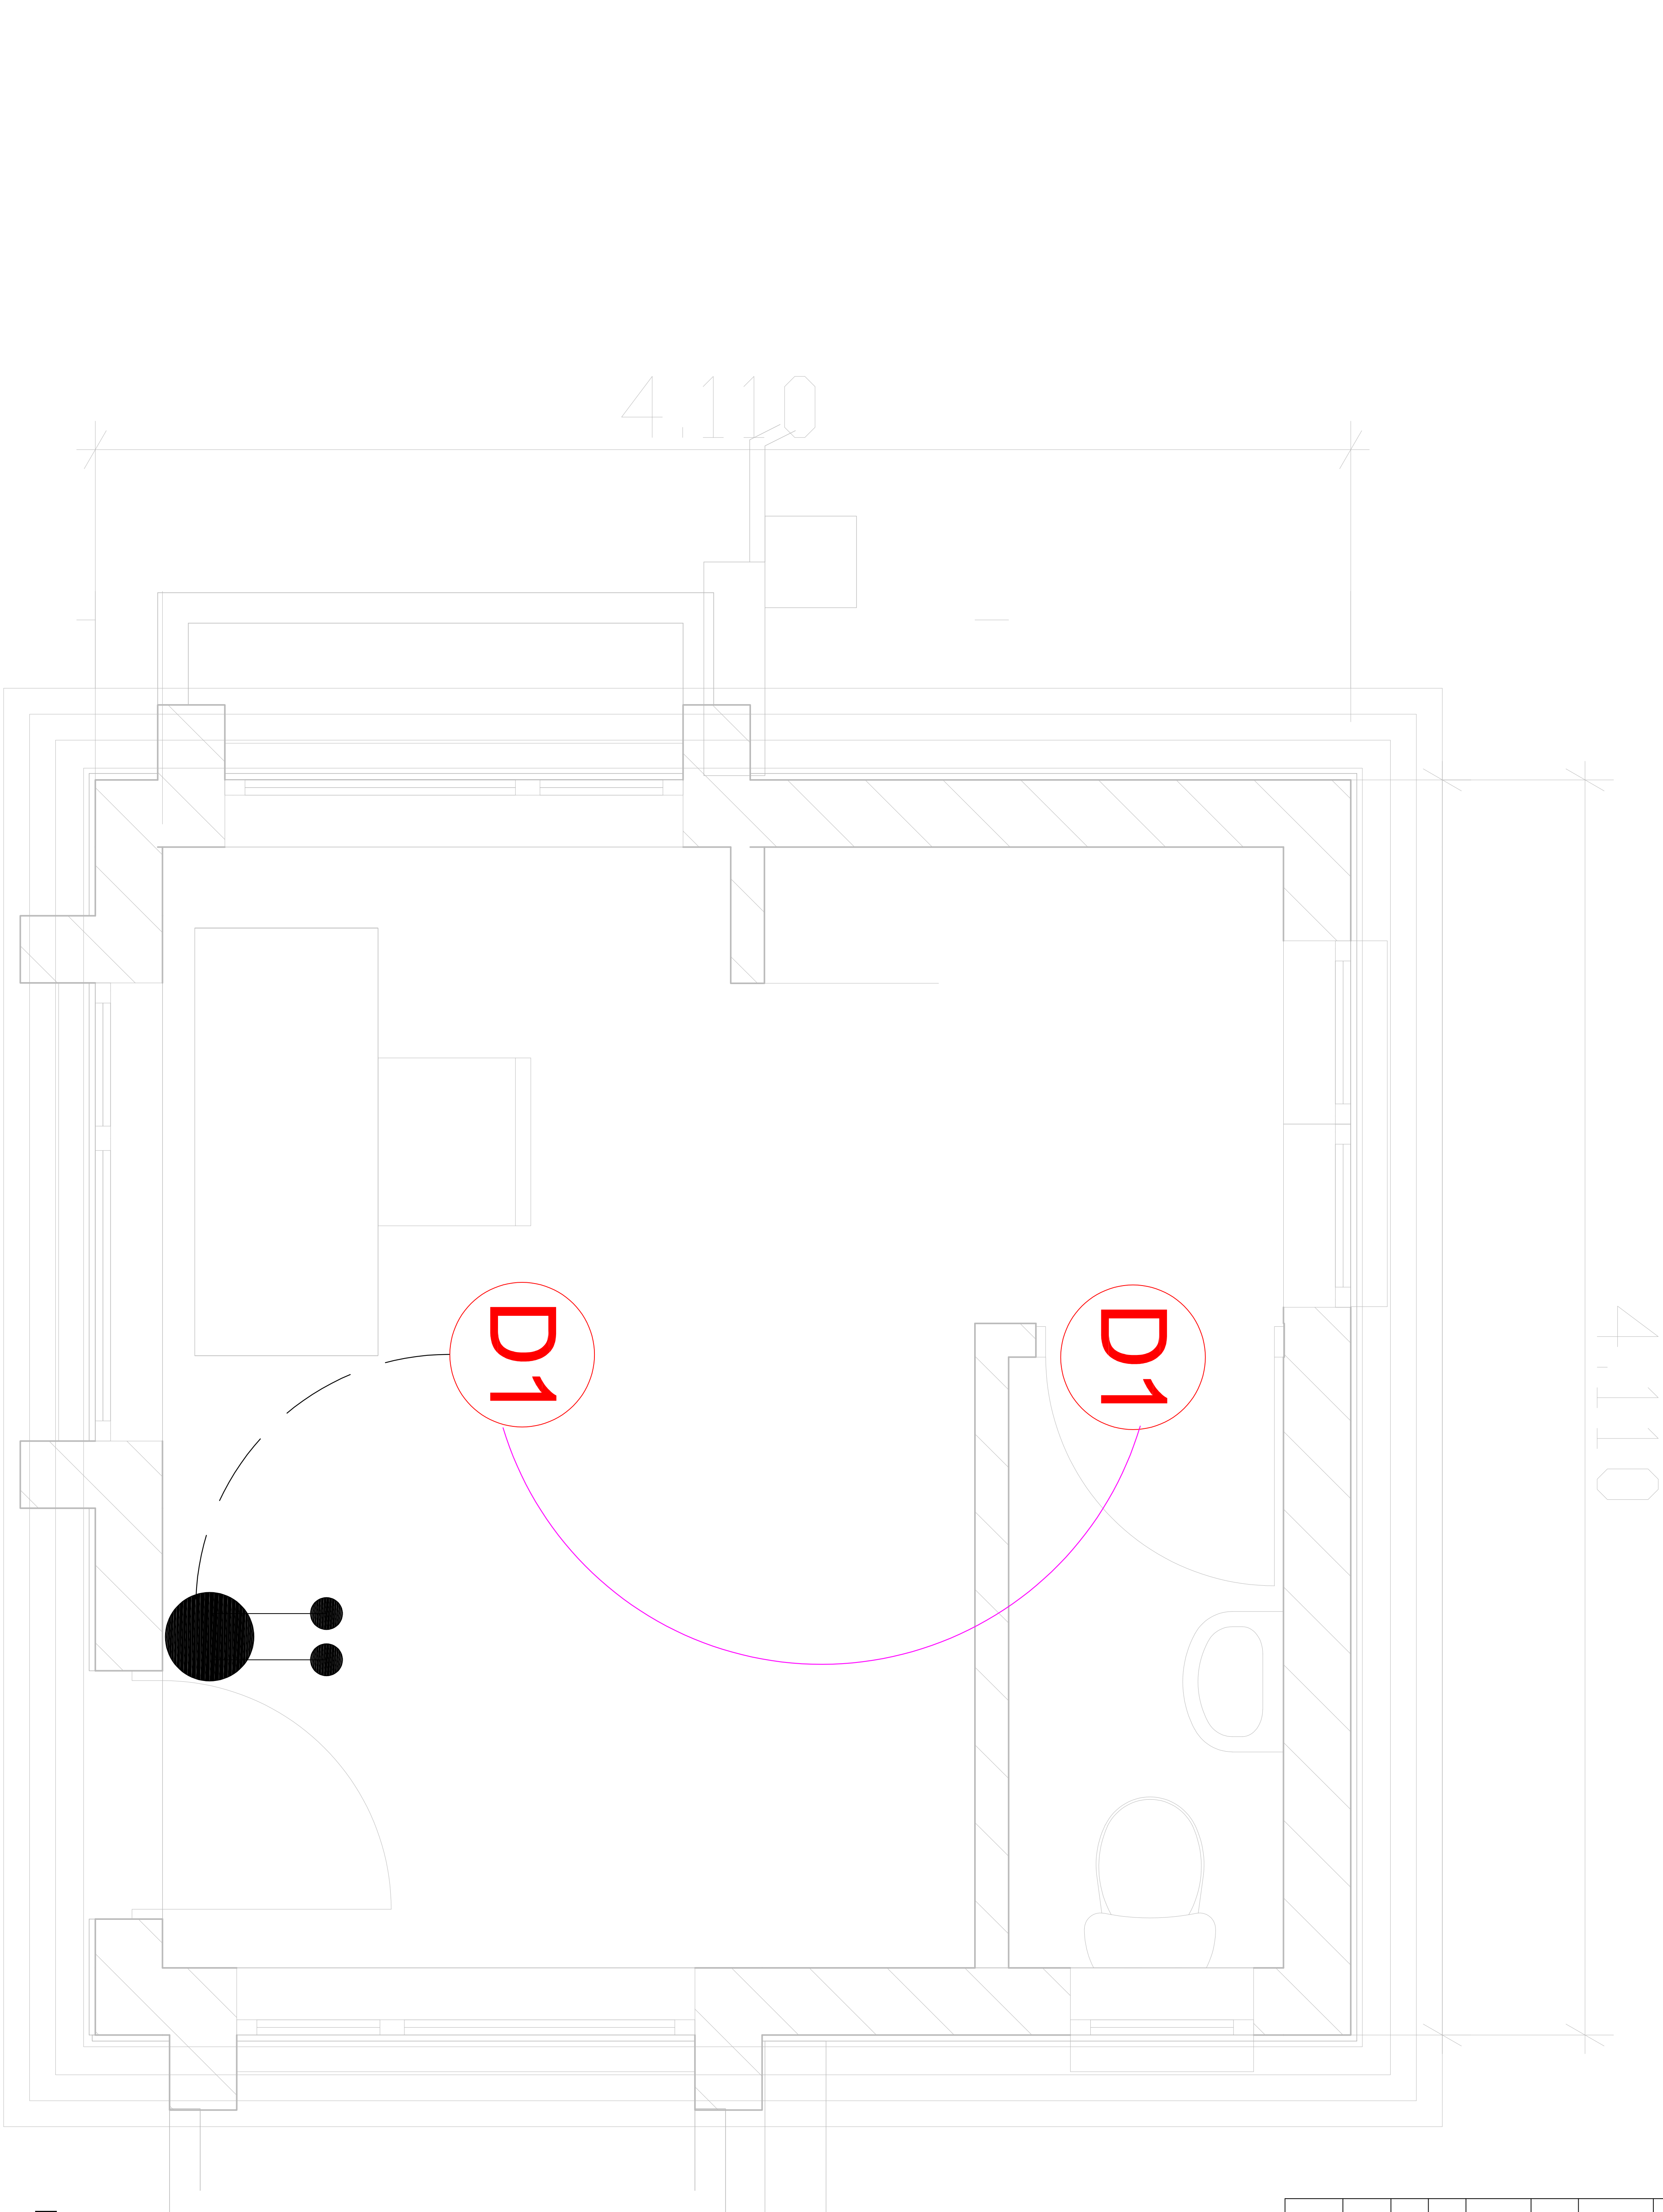

NOTES:

1. ALL LIGHT SWITCHES SHALL BE AT 1400MM A.F.F.L.
2. THE PHOTOCCELL SHALL BE MOUNTED AWAY FROM THE LIGHTS IT IS CONTROLLING TO AVOID CYCLIC.
3. ALL CONDUITS SHALL BE INSTALLED IN THE CEILING AND CHASED INTO WALLS. NO SURFACE CONDUIT SHALL BE ALLOWED.